




PACIFIC LED WT470/480 C/X EL








Installation instructions

Instructions de montage Istruzioni di montaggio
Installation instructions Instrucciones de montaje
Montageanweisung Montážní návod
Montagevoorschrift Montážny návod


Szerelési útmutató
Instrukcja montażu








PACIFIC LED

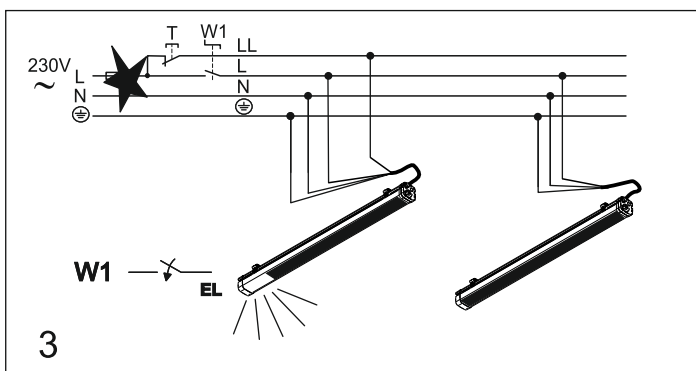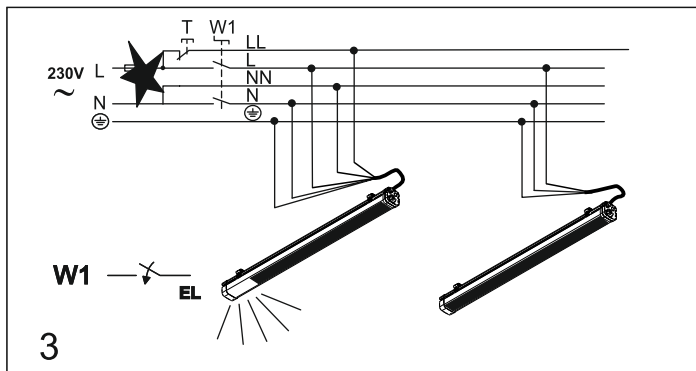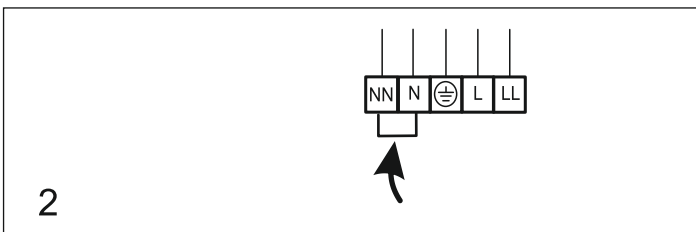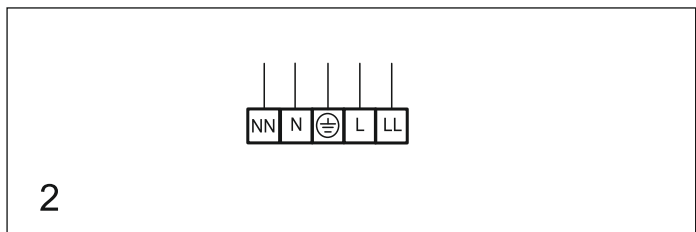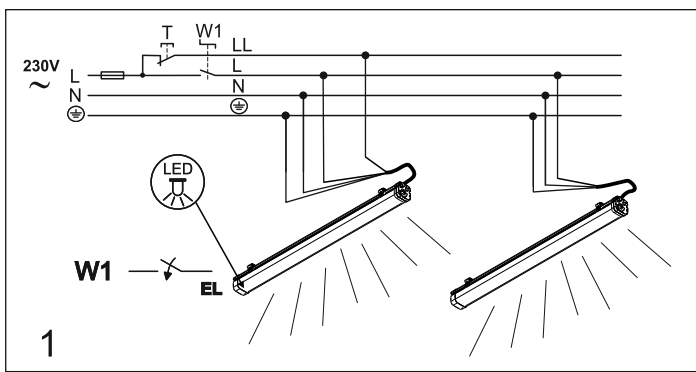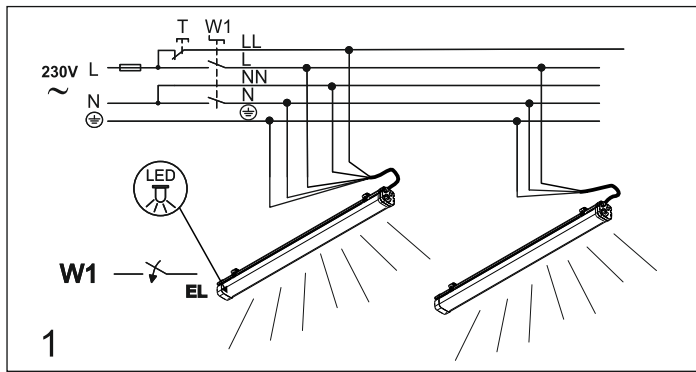

Date of installation
Data instalacji

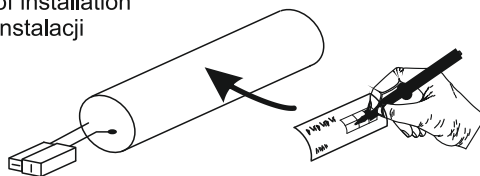

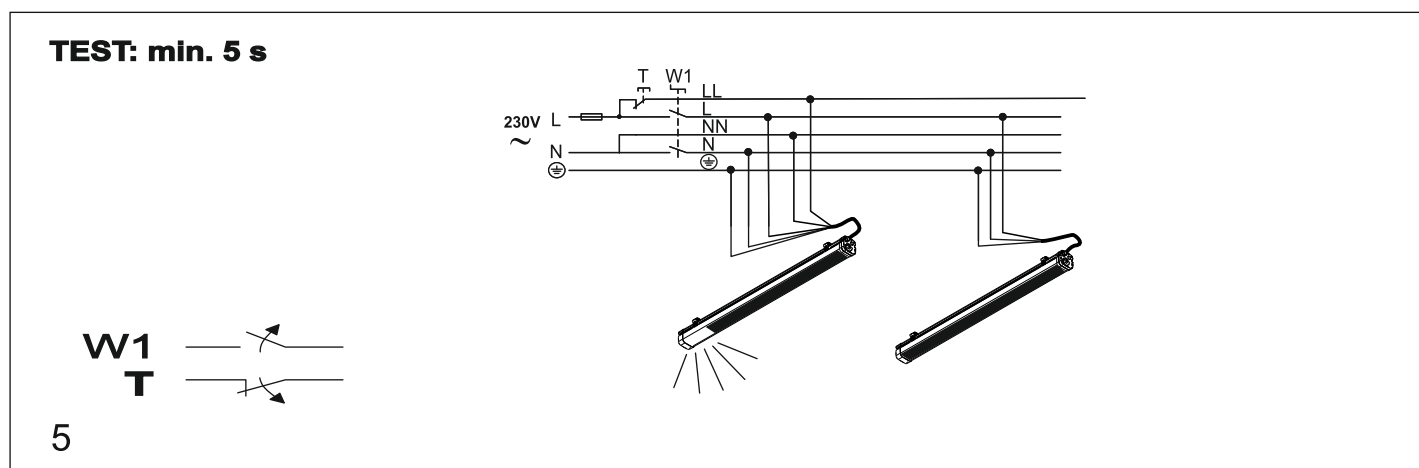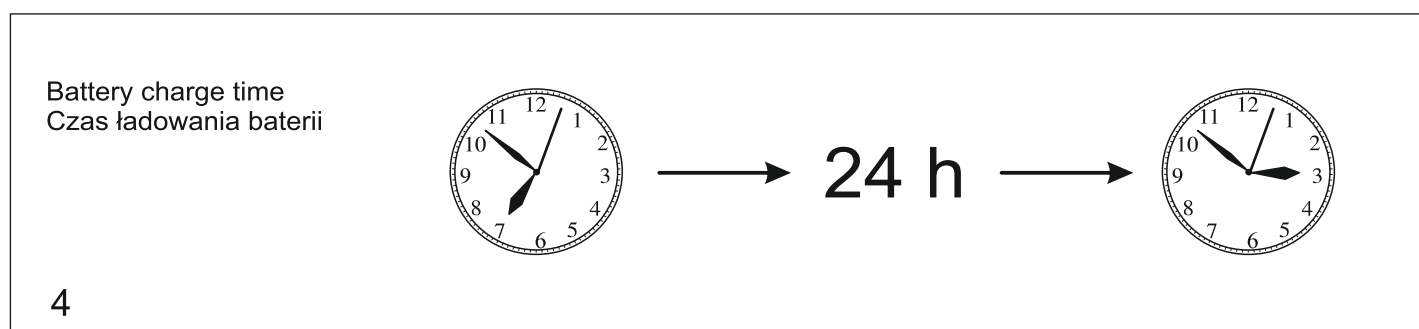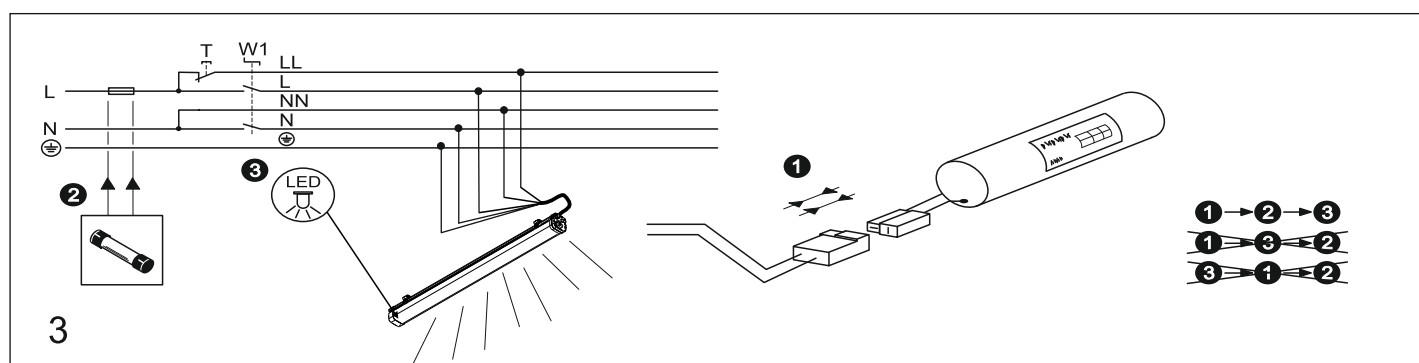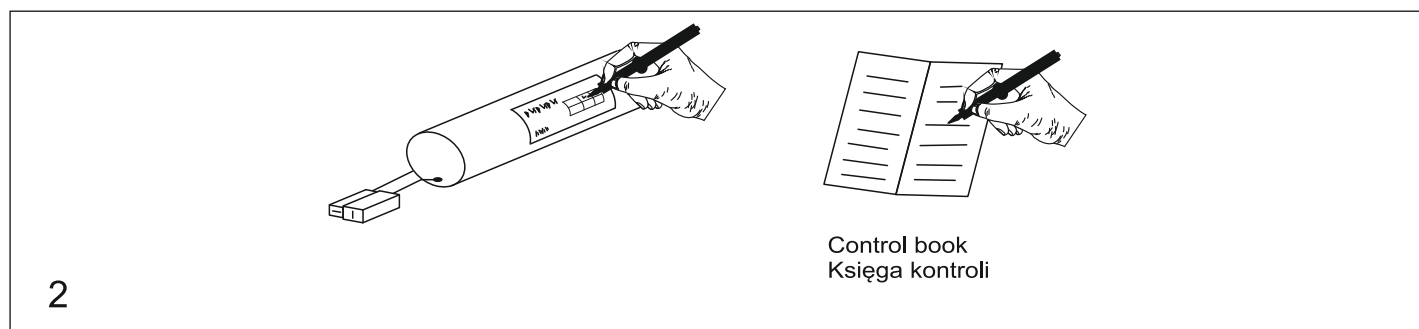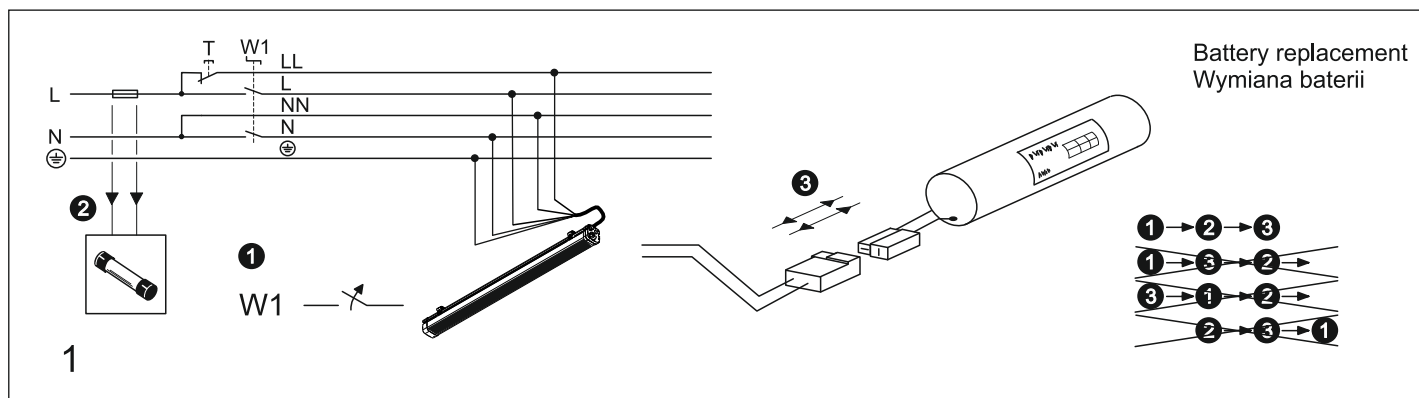

| Type of luminaires | Luminous Flux Lamp in EL mode | Working time in EL mode | Accu Ni-Mh | |
|--------------------|----------------------------------|----------------------------|------------|-------|
| | (lm) | (h) | (V) | (mAh) |
| ELP1 | >600 | 1 | 7,2 | 2500 |
| ELP3 | >360 | 3 | | |
| ELD1 | >600 | 1 | | |
| ELD3 | >360 | 3 | | |

| | | | | | | | | |
|--|------------|------------------|------------|--------------------------|------------|--------------------------|------------|------------------|
| Log book Księga kontroli | | | | | | | | |
| Luminaire no Oprawa nr: | | | | Location Lokalizacja: | | Installer Instalator: | | |
| Mountage Montaż: | | | | | | Date Data: | | |
| Time of emergency mode: Czas świecenia awaryjnego oprawy: [h] | | | | | | | | |
| Test of emergency lighting: Test zaświecenia awaryjnego: | | | | | | | | |
| half - year | 1 year/rok | | 2 year/rok | | 3 year/rok | | 4 year/rok | |
| półrocze | Data/Date | Podpis/Signature | Data/Date | Podpis/Signature | Data/Date | Podpis/Signature | Data/Date | Podpis/Signature |
| I | | | | | | | | |
| II | | | | | | | | |

TEST OF EMERGENCY MODE (every 6 month)
 TEST ZAŚWIECENIA AWARYJNEGO (co 6 miesięcy)