

PowerBalance gen2 RC460B/461B/462B/463B/467B/468B

Installation instructions

Instructions de montage

Montageanleitung

Montage instructie

Istruzioni di montaggio

Instrucciones de montaje

Instruções de montagem

Monteringsinstruktioner

Monteringsvejledning

Kokoonpano- ja kiinnitysohjeet

Montaj yönergeleri

Οδηγίες συναρμολόγησης

Instrukcja montazu

Szerelési utasítások

Návod k montáži




ИНСТРУКЦИЯ ПО МОНТАЖУ

Návod k montáži

This luminaire must be earthed.
Ce luminaire doit être mis à la terre.
Diese Leuchte muß geerdet werden.
Dit armatuur moet worden geaard.
Questa armatura deve essere collegata a terra.
La Luminaria debe estar conectada a tierra.



Class I

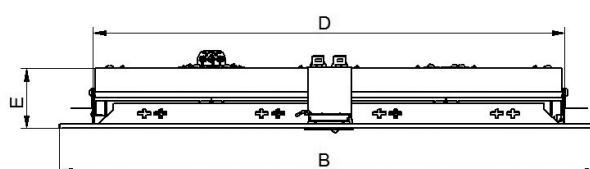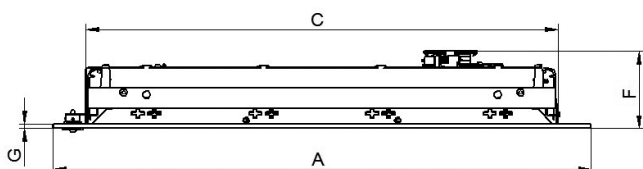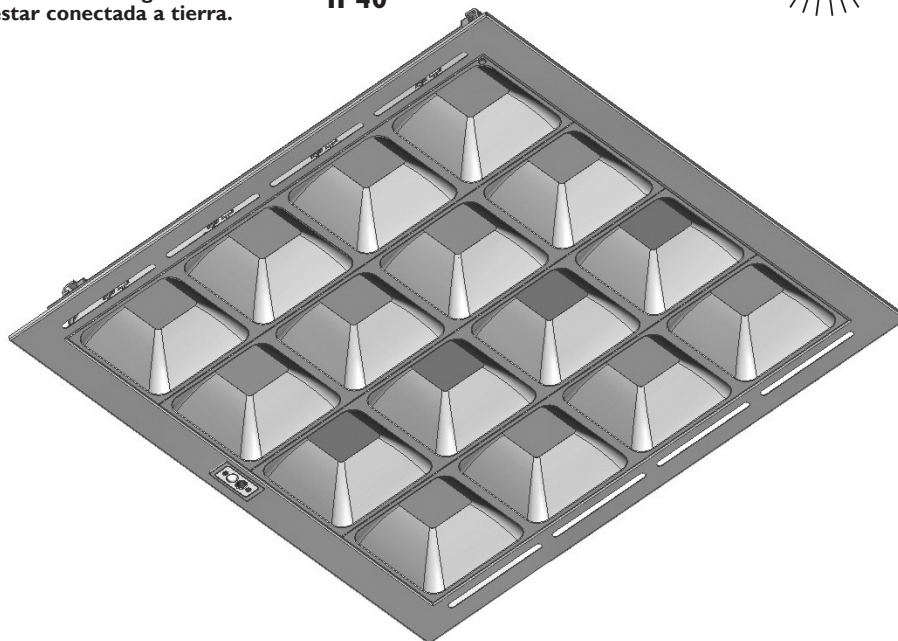


Generatie 2 !

		A	B	C	D	E	F	G	weight
MODULE 600									
Square	RC460B/RC461 W60/L60	597	597	524	524	67	86	5	5.7kg
MODULE 625									
Square	RC462B/RC463 W62/62	622	622	524	524	67	86	5	5.9kg
MODULE 675									
Square	RC467B/RC468 W67/67	672	672	524	524	67	86	5	6.4kg

Xitanium 75W/200V TD 230V

Inrush Current Peak	48 (max) A
Mains current pulse time half peak	1mS
Earth leakage current	0.7 (max) mA
Max drivers on MCB (16A type-B)	20 max
Number of ballasts connected to one 30mA residual current detector	30 max

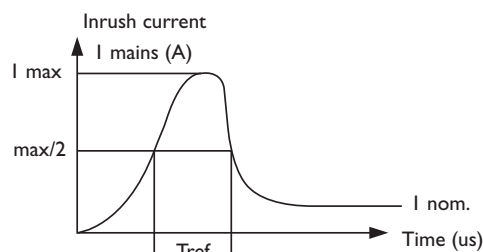

PHILIPS

Sym-concealed




A-sym-concealed






Click-in Profile










! ATTENTION







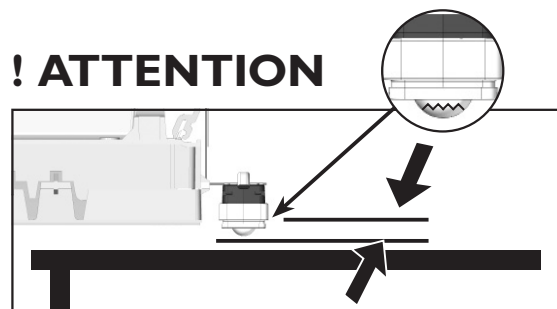


Lay-in

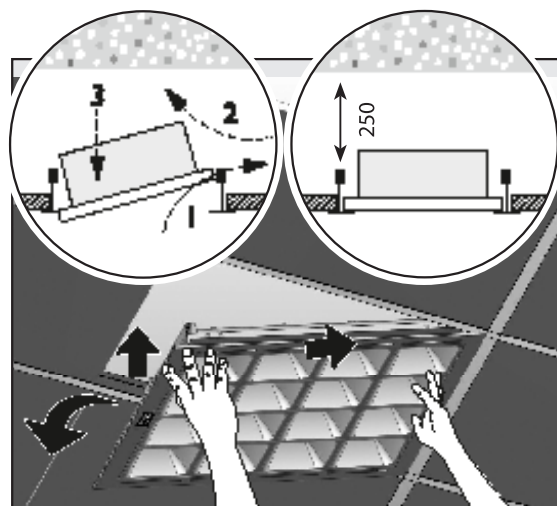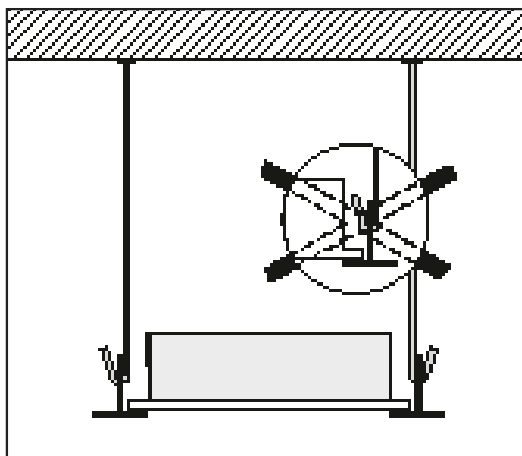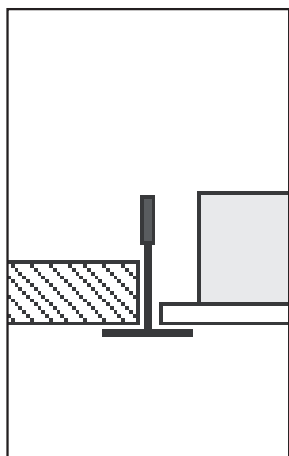


Concealed | PLC

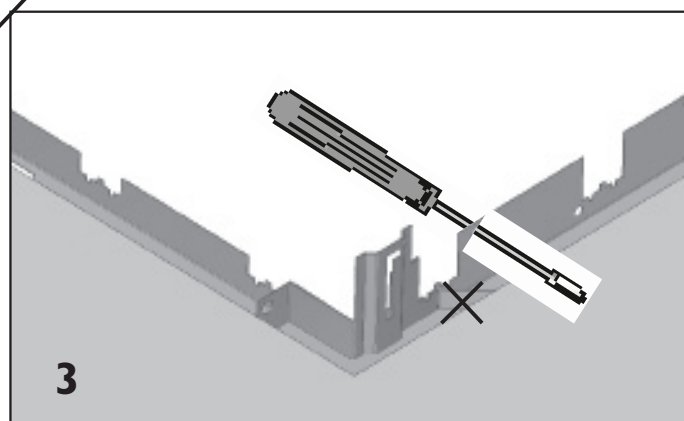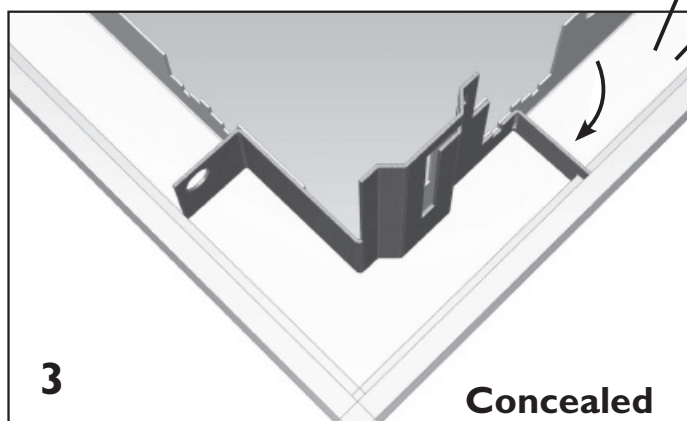
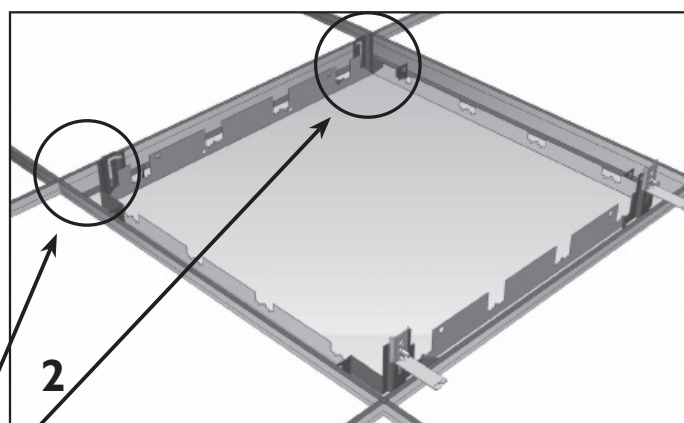
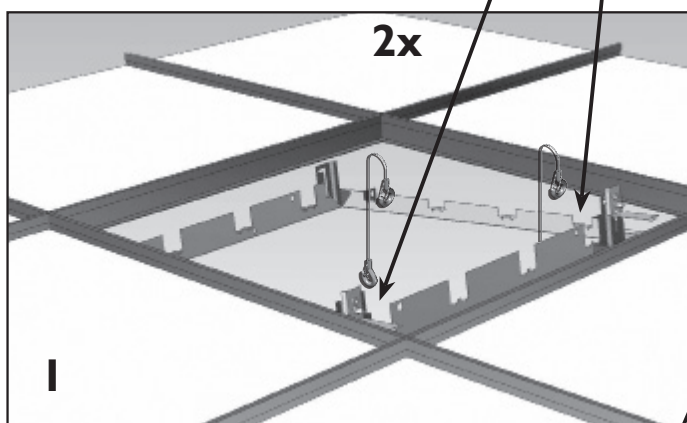
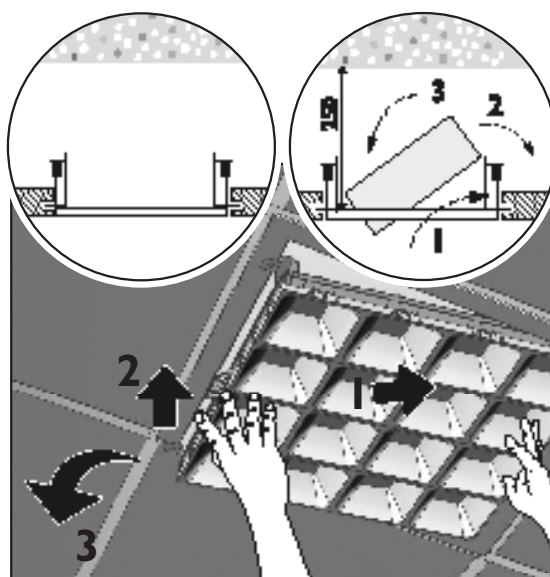
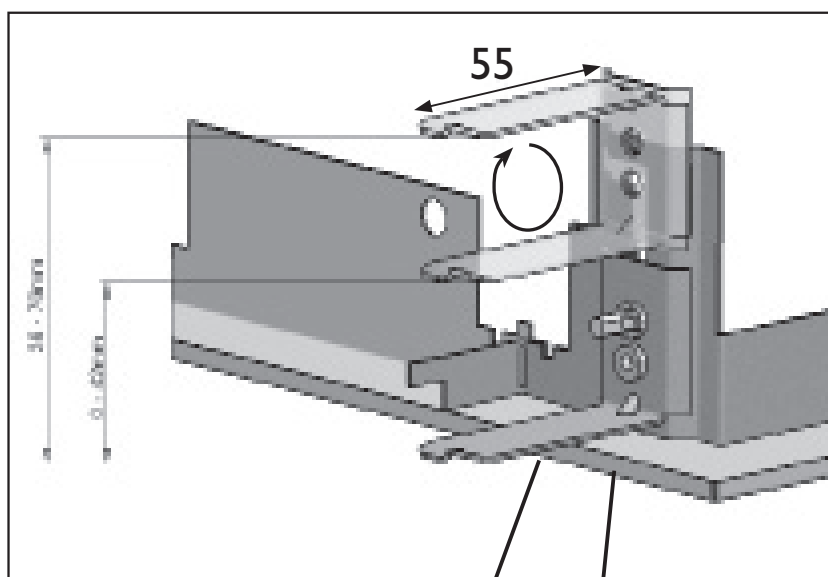
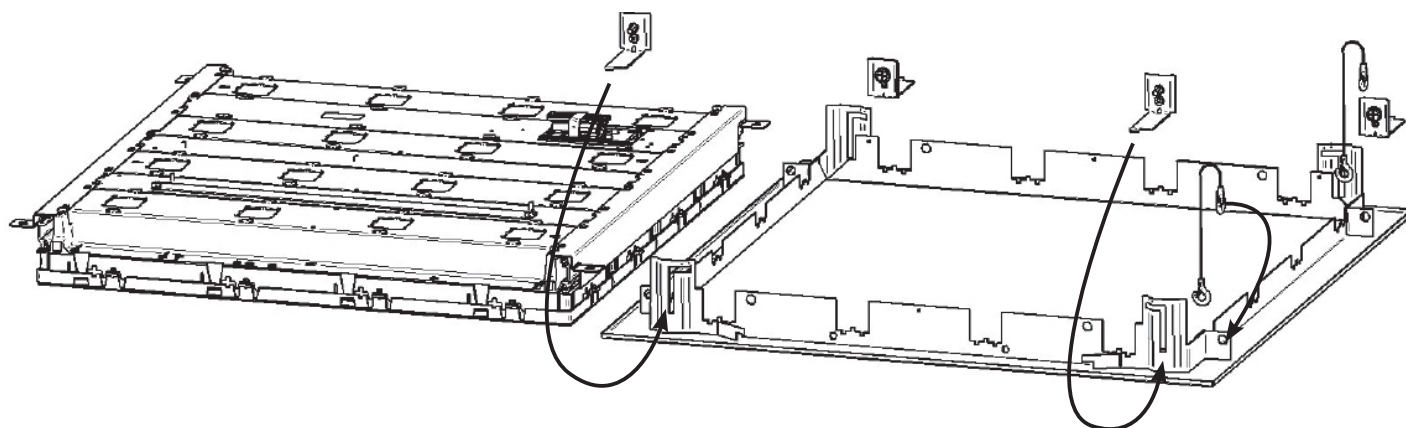


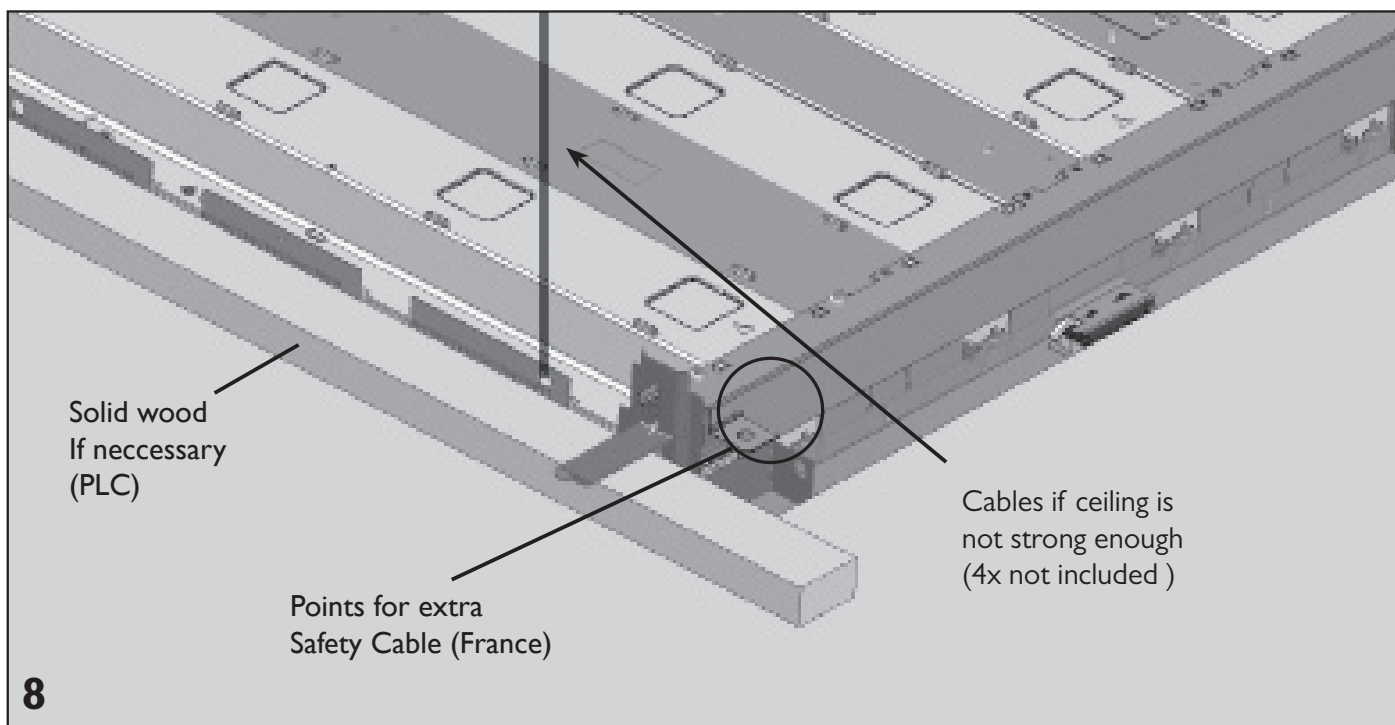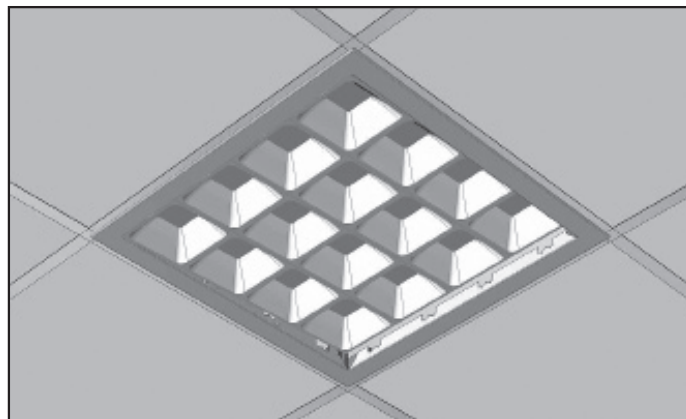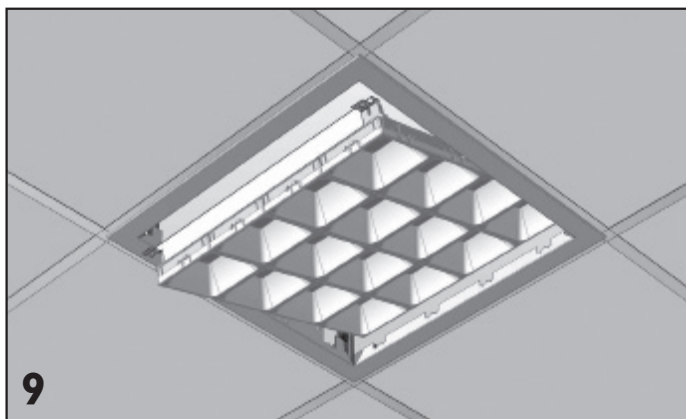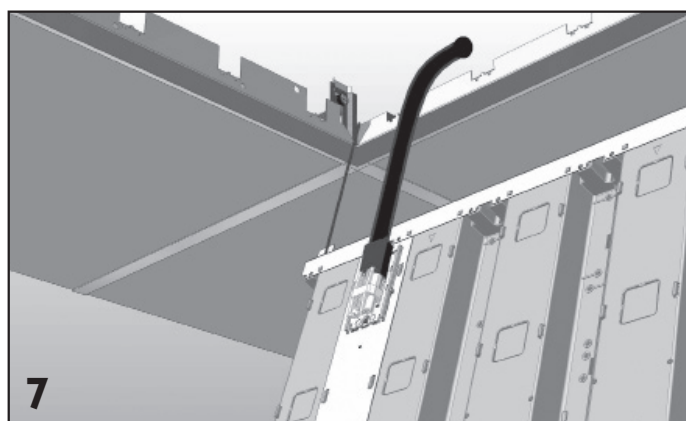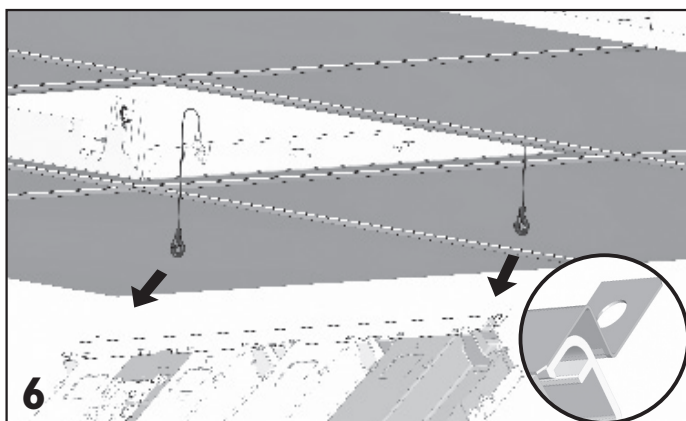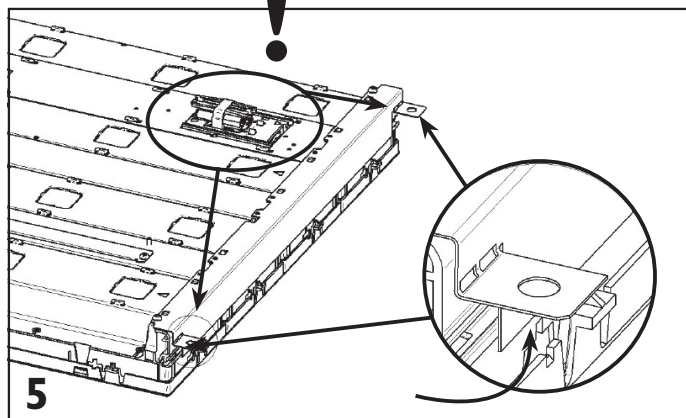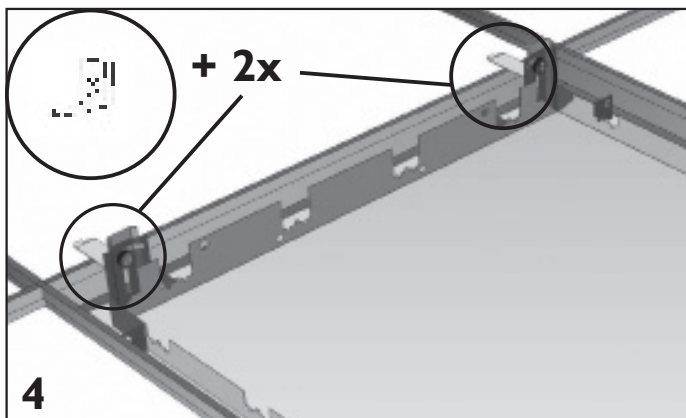

PLC

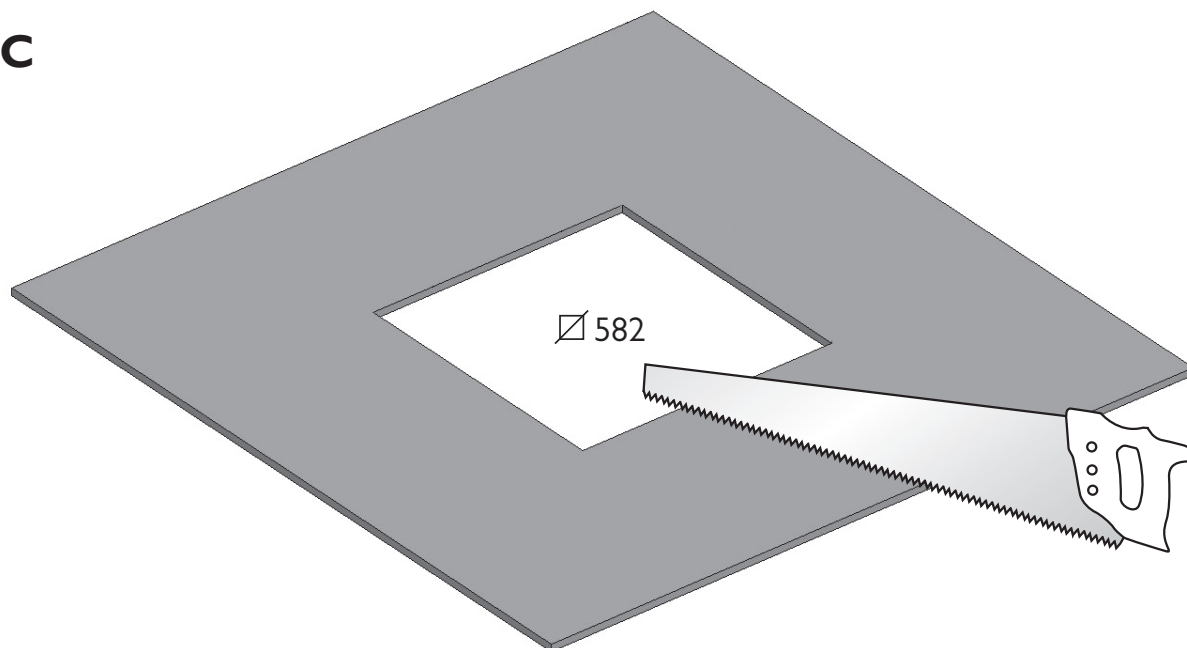


Push-In (PI)

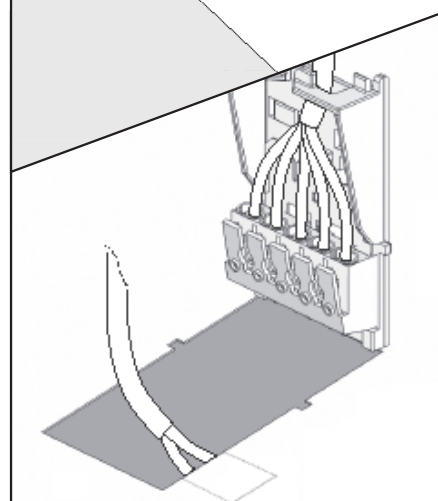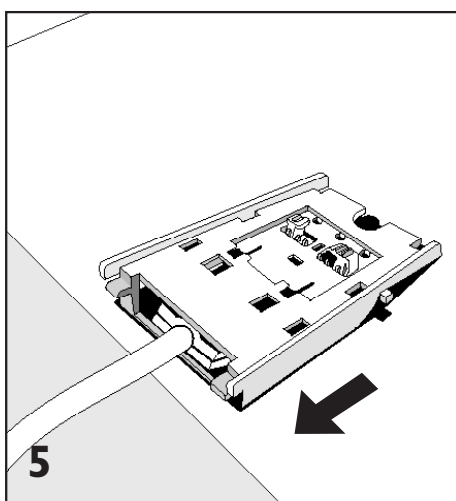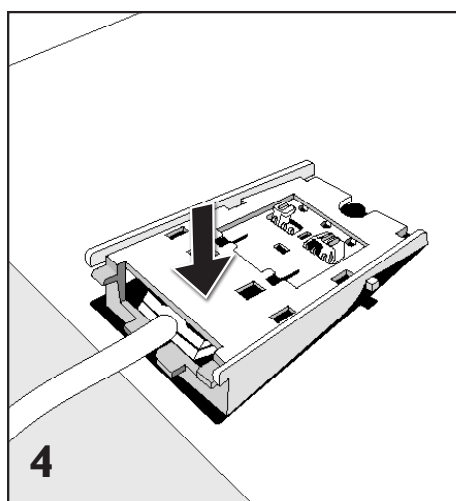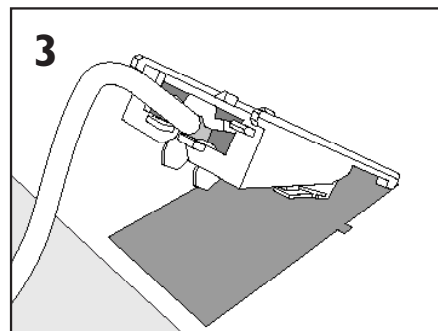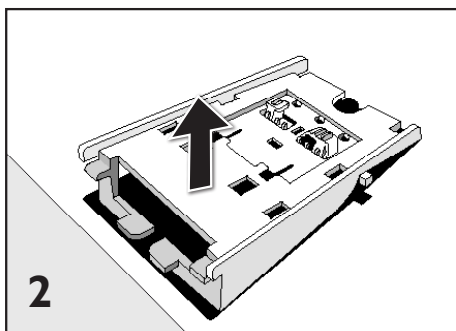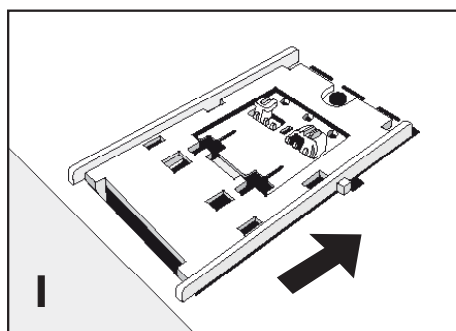


Push-in (PIP)



PSU

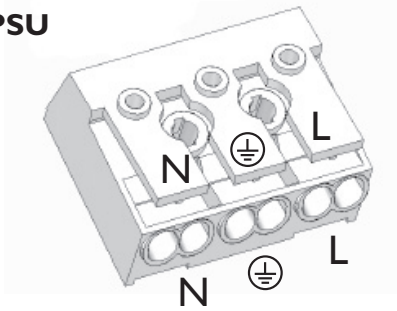


PSD

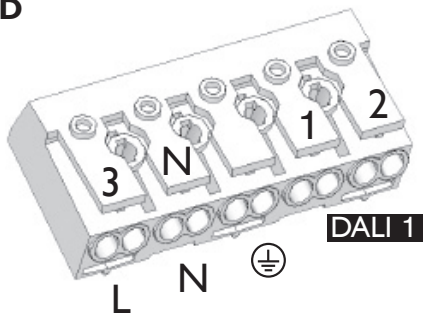



PSD+ACL

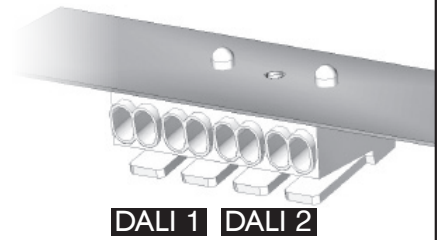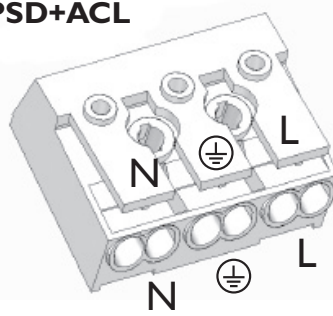


PSD-T

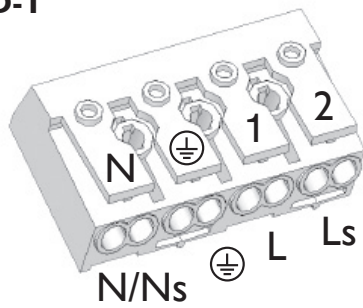



PSD-EL

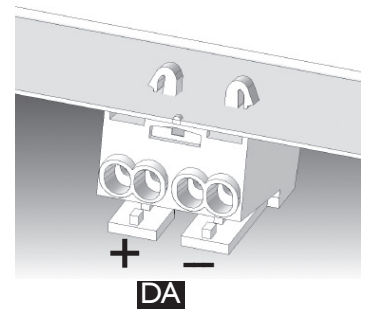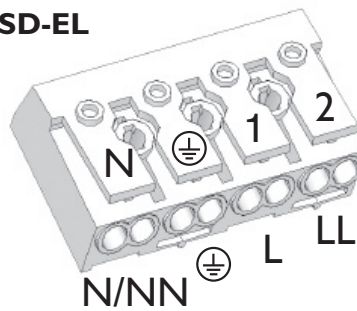








PSU-EL

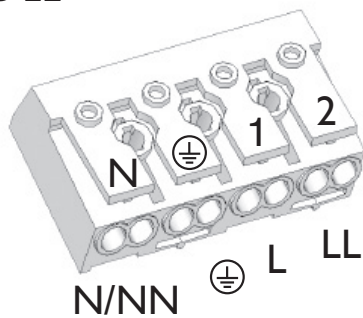


PSD-T+ACL

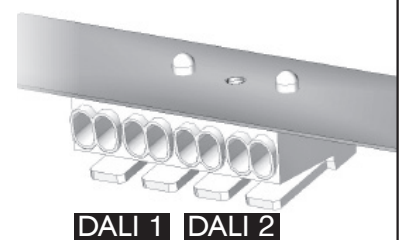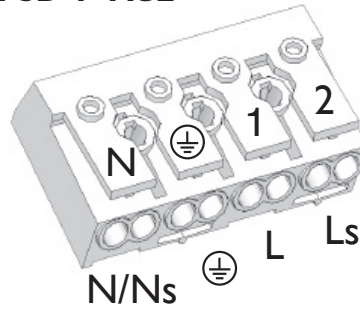

Wieland (W)

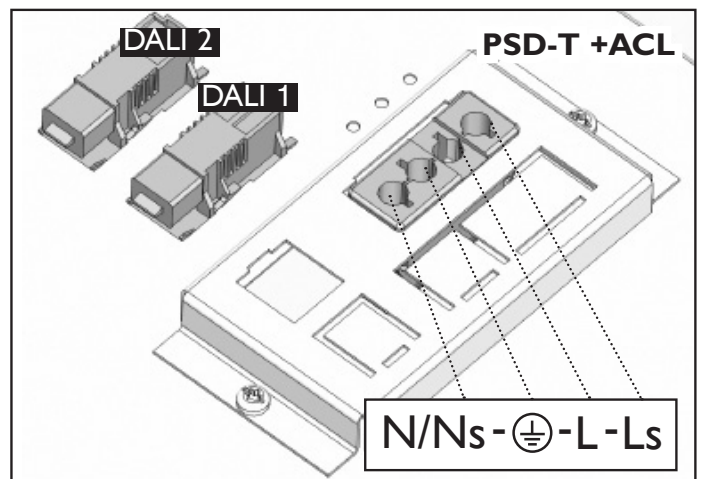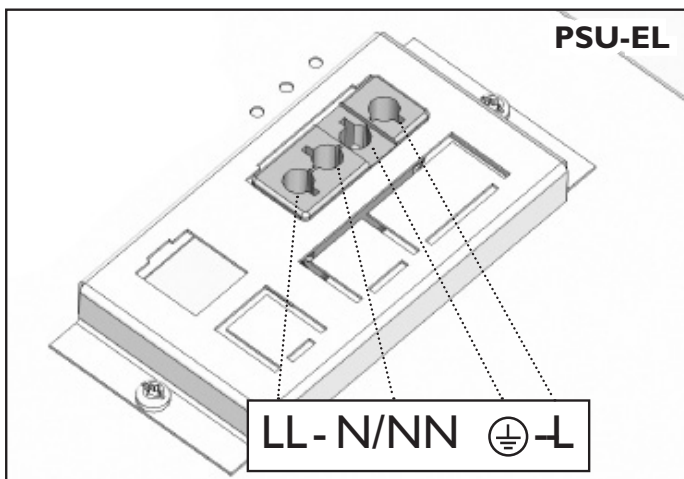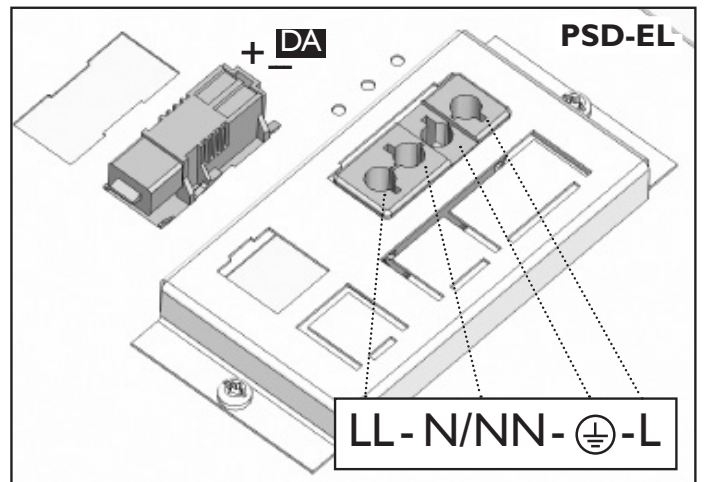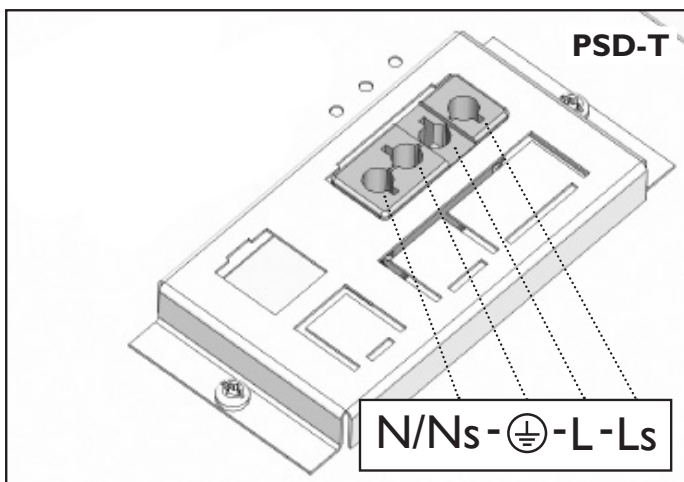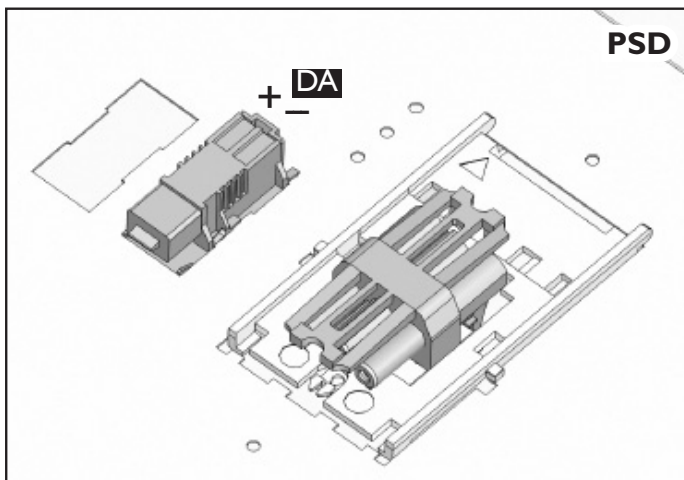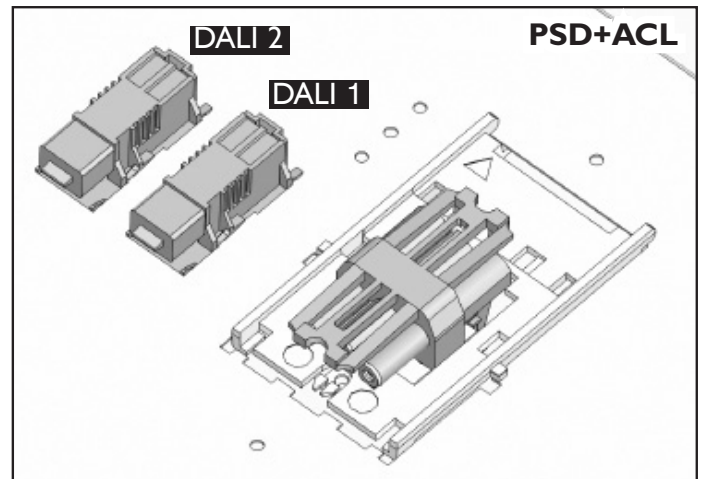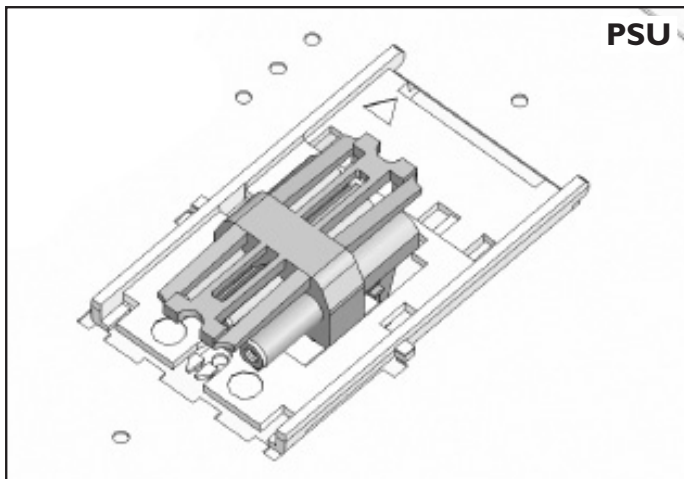

For use in ventilated space (EN/IEC 60598-2-19)

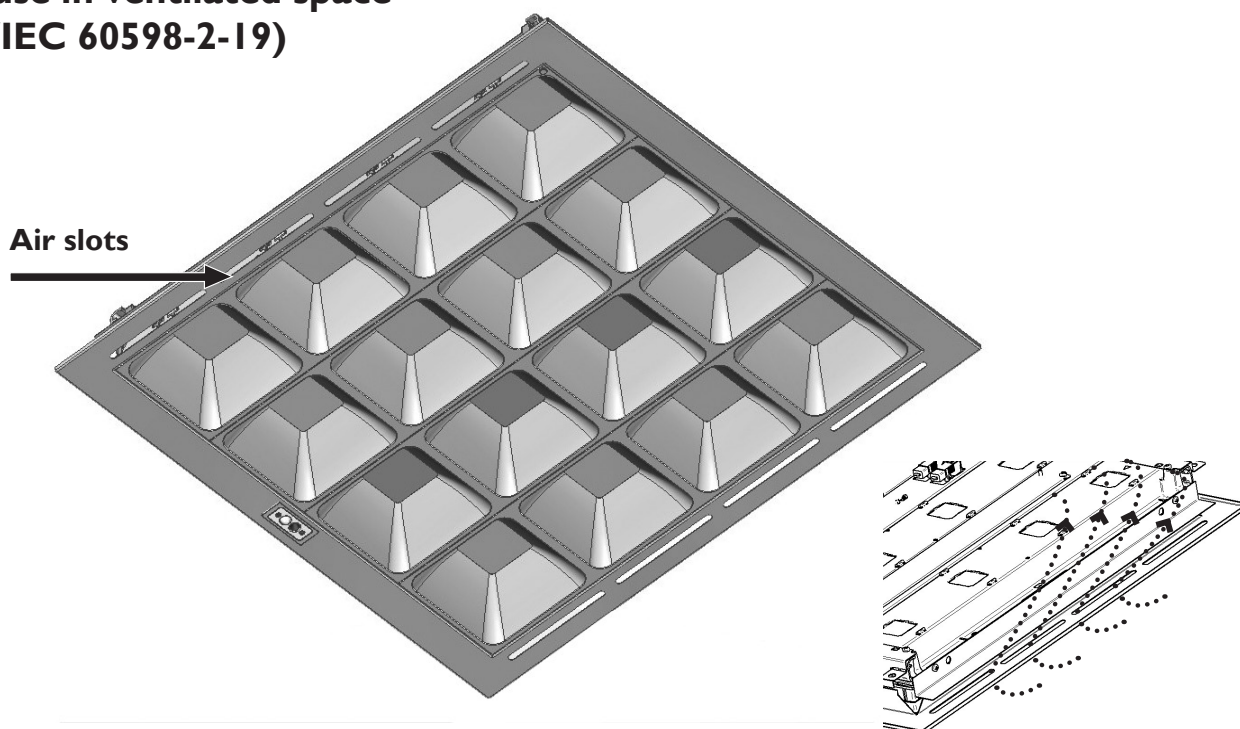

Powerbalance gen2 Lighting Technology

Maintenance instructions

Given the choices made in this unique lighting concept, there are a few instructions regarding the maintenance of this luminaire to assure the lighting qualities:

- ☐ During installation or maintaining the luminaire please use gloves to avoid spots on the cover.

- ☐ Dirty spots can be removed:


- Only dust: with micro fiber cloth
- Fingerprints, etc.: with a cleaner for synthetic material with antistatic effect.

- ☐ Remove the protection foil on the cover only short before usage of the lighting installation.

- ☐ Do not touch electronic components! ESD sensitive.

- ☐ Do not stare into LED beam.

- ☐ Luminaire should not be used for illumination during building activities due to dust contamination of the optics.



NOTE:

Don't use plastic gloves.

