



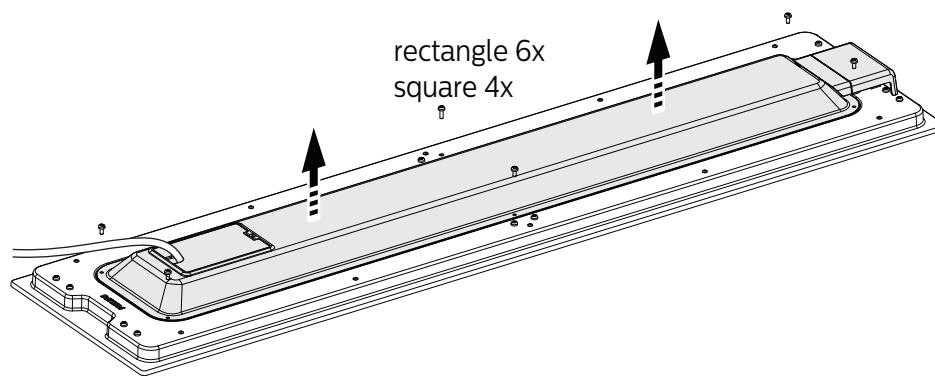


Emergency Luminaires with Batteries


Battery replacement



1

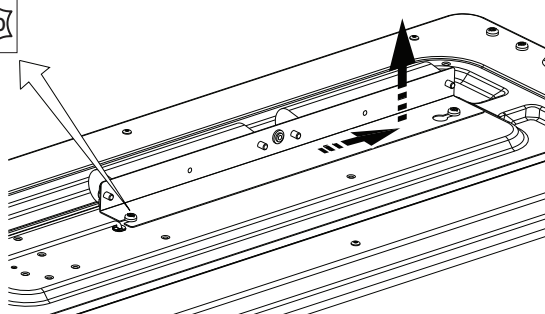


2

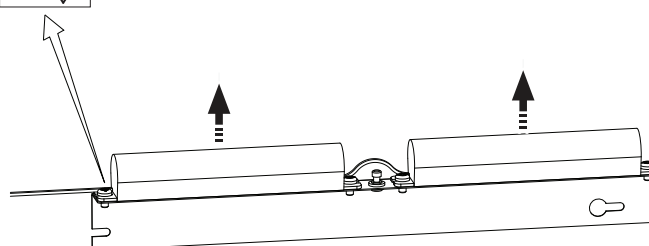

3


W60L60

Rated light output in emergency operation mode: 350lm

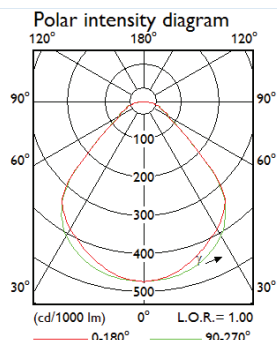


W30L120

Rated light output in emergency operation mode: 350lm

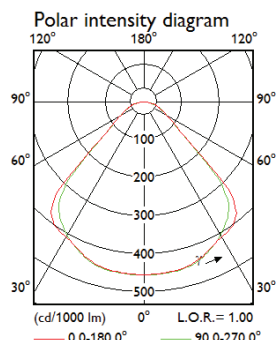


W62L62

Rated light output in emergency operation mode: 350lm

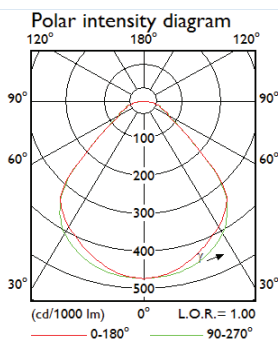

W31L125

Rated light output in emergency operation mode: 350lm

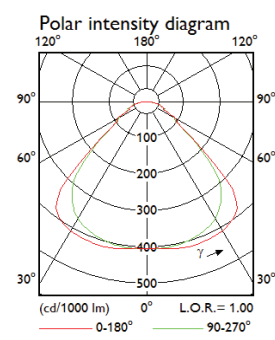

Charge time



→ 24.00 →



Lifetime

The batteries have a life time expectancy of 4 years when maintained properly. Replace after that time!

Periodic testing

Periodic tests should be performed according to EN 50172:2004, clause 7.2.3 and 7.2.4. Each month the driver is running in emergency mode for 30 seconds.

Once a year a full discharge cycle of at least 1hr or 3 hrs (depending on product installed) should be performed.

The tests could be done by complete disconnection of the luminaire