



Installation of Emergency unit


Installation of Emergency Lighting Kit

(Not included, order separately)



This product is only compatible with:

912401483602 EM300V ELB ELP3 kit LV 3.6V 4900mAh LB



1 Labels




Located on the battery



OR





Stick to/ into the luminaire



Stick the kit to the luminaire


2 Connection

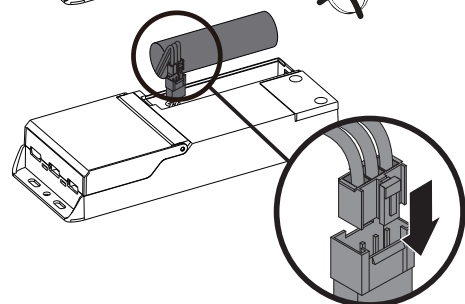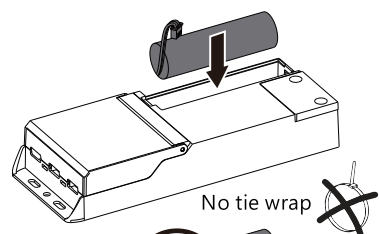

3 Log book





4 Cut-out




Cut-out: Ø20mm




5 Set test mode

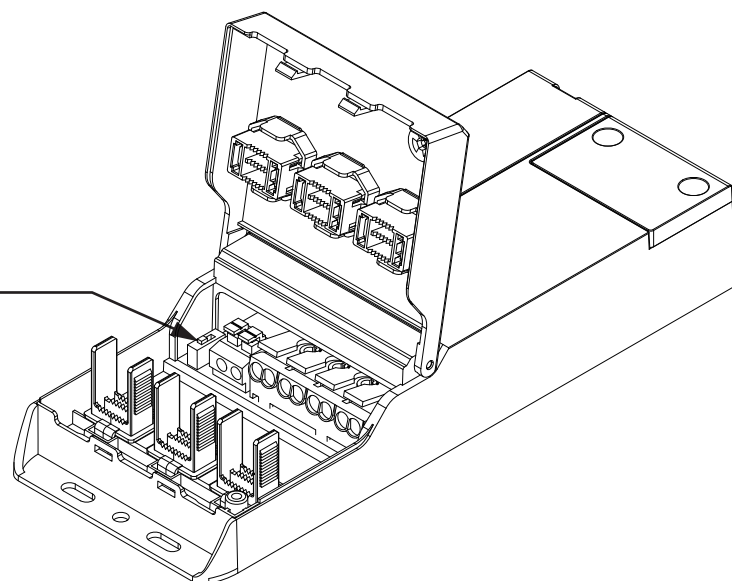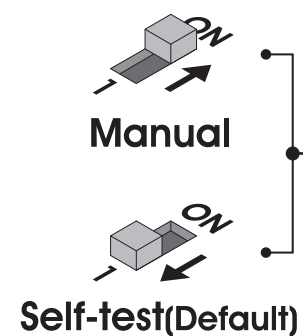

Emergency wiring

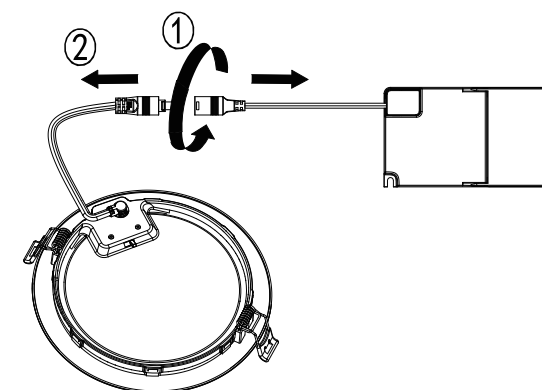

Driver output current $\leq 2A$

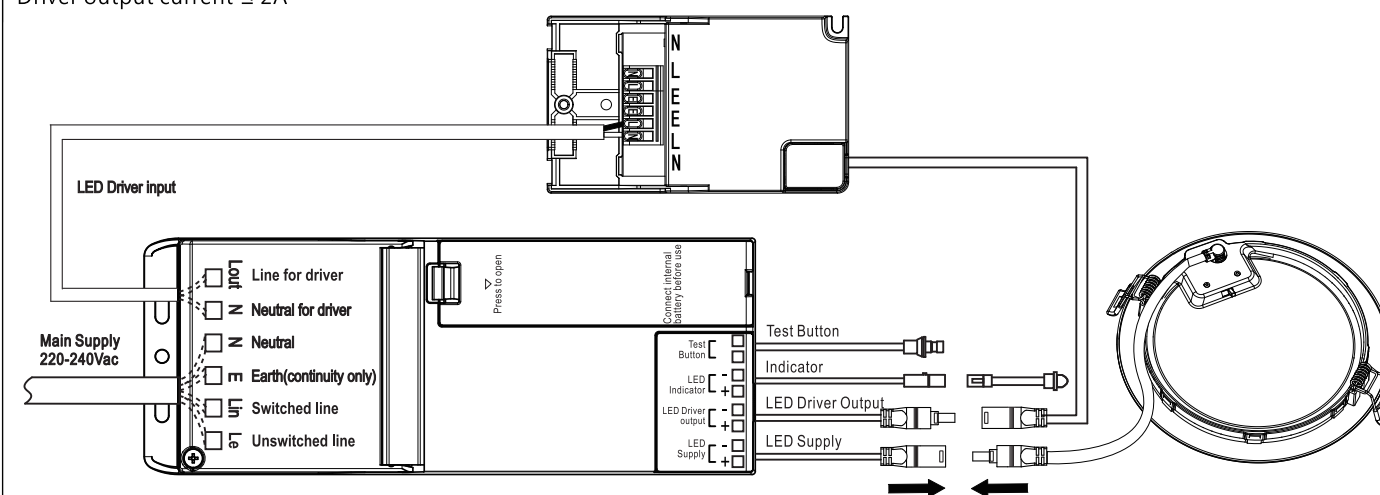

Charge time



Emergency Lumen Output

Rated lumen output in emergency mode:

DN145B LED6S/830_840 WH: min 270lm

DN145B LED10S/830_840 WH: min 280lm

DN145B LED20S/830_840 WH: min 290lm

