



Strip 1 x 9290026949 4000K

1 x 300 lm


Polar intensity diagram

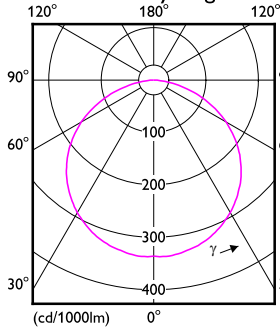

Quantity estimation diagram

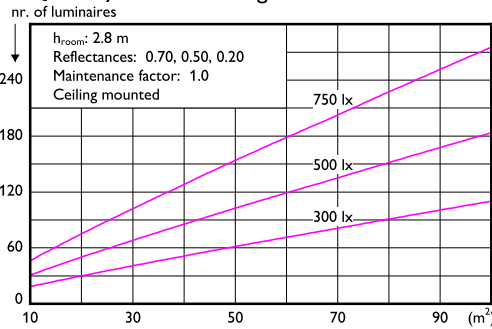

UGR diagram

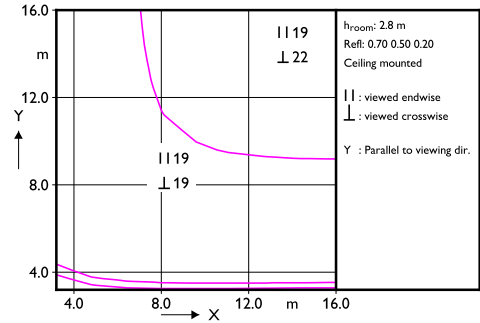

Light output ratio 1.00
Service upward 0.00
Service downward 1.00

CIE flux code 46 79 96 100 100

UGRcen (4Hx8H, 0.25H) 19

Utilisation factor table

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)											
	0.80	0.80	0.70	0.70	0.70	0.70	0.50	0.50	0.30	0.30	0.00	0.00
0.60	0.50	0.50	0.50	0.50	0.50	0.30	0.30	0.10	0.10	0.10	0.00	0.00
0.80	0.30	0.10	0.30	0.20	0.10	0.10	0.10	0.10	0.10	0.10	0.00	0.00
1.00	0.47	0.45	0.47	0.45	0.44	0.37	0.36	0.32	0.36	0.31	0.29	0.29
1.25	0.58	0.55	0.57	0.56	0.54	0.46	0.46	0.41	0.45	0.40	0.38	0.38
1.50	0.67	0.63	0.66	0.64	0.62	0.54	0.53	0.48	0.53	0.48	0.46	0.46
2.00	0.76	0.70	0.74	0.72	0.69	0.62	0.61	0.56	0.60	0.56	0.53	0.53
2.50	0.83	0.75	0.81	0.77	0.74	0.68	0.67	0.62	0.65	0.61	0.59	0.59
3.00	0.93	0.83	0.90	0.86	0.82	0.76	0.75	0.71	0.74	0.70	0.68	0.68
4.00	1.00	0.88	0.97	0.92	0.87	0.82	0.81	0.77	0.79	0.76	0.74	0.74
5.00	1.04	0.91	1.01	0.96	0.90	0.86	0.85	0.81	0.83	0.80	0.78	0.78
	1.10	0.96	1.07	1.00	0.94	0.91	0.89	0.87	0.88	0.86	0.83	0.83
	1.14	0.98	1.11	1.03	0.97	0.94	0.92	0.90	0.91	0.89	0.86	0.86

Ceiling mounted

Luminance Table

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0	2490	2412	2344	2288	2247	2222	2214
50.0	2472	2380	2301	2236	2190	2161	2152
55.0	2430	2323	2231	2158	2105	2073	2063
60.0	2382	2255	2149	2066	2006	1970	1958
65.0	2283	2135	2013	1920	1853	1814	1801
70.0	2149	1974	1835	1730	1657	1615	1601
75.0	1917	1711	1555	1442	1366	1322	1308
80.0	1601	1353	1182	1067	992	951	938
85.0	1116	815	652	556	500	470	461
90.0	47500	292	152	107	88	79	76

(cd/m²)

2021-08-11