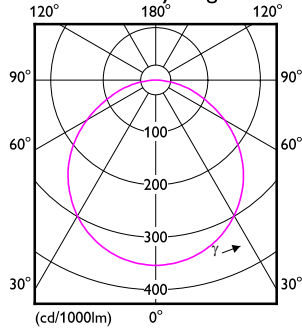
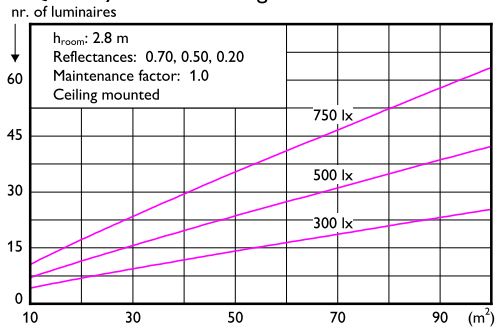
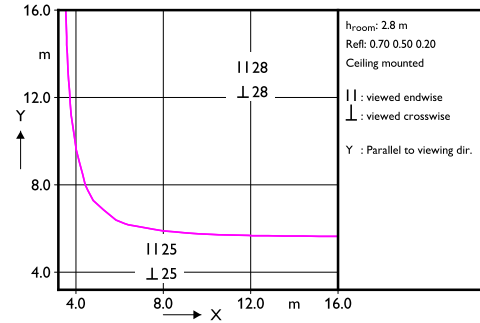


Downlight 1 x 9290046539 6500K

1 x 1300 lm

Polar intensity diagram**Quantity estimation diagram****UGR diagram**

Light output ratio 1.00
Service upward 0.00
Service downward 1.00

CIE flux code 47 79 96 100 100

UGRcen (4Hx8H, 0.25H) 26

Utilisation factor table

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)															
	0.80 0.80				0.70 0.70				0.50 0.50				0.30 0.30			
	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10	0.50 0.50	0.30 0.10
0.60	0.48	0.46	0.47	0.46	0.45	0.38	0.37	0.32	0.37	0.32	0.37	0.32	0.30	0.30	0.30	0.30
0.80	0.59	0.55	0.58	0.56	0.55	0.47	0.46	0.41	0.46	0.41	0.46	0.41	0.39	0.39	0.39	0.39
1.00	0.68	0.63	0.66	0.64	0.62	0.55	0.54	0.49	0.53	0.49	0.53	0.49	0.46	0.46	0.46	0.46
1.25	0.77	0.70	0.75	0.72	0.69	0.62	0.61	0.56	0.60	0.56	0.60	0.56	0.54	0.54	0.54	0.54
1.50	0.83	0.75	0.81	0.78	0.74	0.68	0.67	0.62	0.66	0.62	0.66	0.62	0.59	0.59	0.59	0.59
2.00	0.93	0.83	0.91	0.86	0.82	0.77	0.75	0.71	0.74	0.71	0.74	0.71	0.68	0.68	0.68	0.68
2.50	1.00	0.88	0.97	0.92	0.87	0.82	0.81	0.77	0.80	0.76	0.80	0.76	0.74	0.74	0.74	0.74
3.00	1.05	0.92	1.02	0.96	0.90	0.86	0.85	0.82	0.83	0.81	0.83	0.81	0.78	0.78	0.78	0.78
4.00	1.11	0.96	1.07	1.01	0.95	0.91	0.90	0.87	0.88	0.86	0.88	0.86	0.83	0.83	0.83	0.83
5.00	1.14	0.98	1.11	1.04	0.97	0.94	0.93	0.90	0.91	0.89	0.91	0.89	0.86	0.86	0.86	0.86

Ceiling mounted

Luminance Table

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0	17861	17861	17861	17861	17861	17861	17861
50.0	17447	17447	17447	17447	17447	17447	17447
55.0	16874	16874	16874	16874	16874	16874	16874
60.0	16115	16115	16115	16115	16115	16115	16115
65.0	15199	15199	15199	15199	15199	15199	15199
70.0	14231	14231	14231	14231	14231	14231	14231
75.0	13517	13517	13517	13517	13517	13517	13517
80.0	12357	12357	12357	12357	12357	12357	12357
85.0	9074	9074	9074	9074	9074	9074	9074
90.0	3771	3771	3771	3771	3771	3771	3771

(cd/m²)

2024-11-11