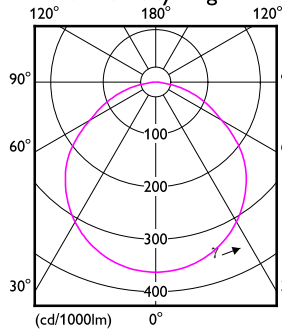
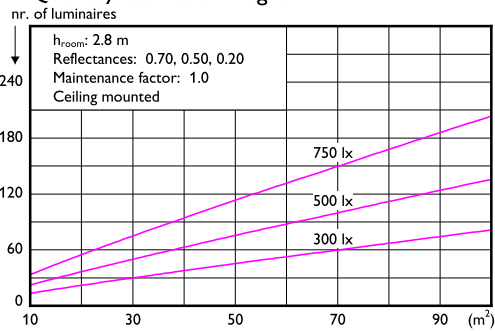
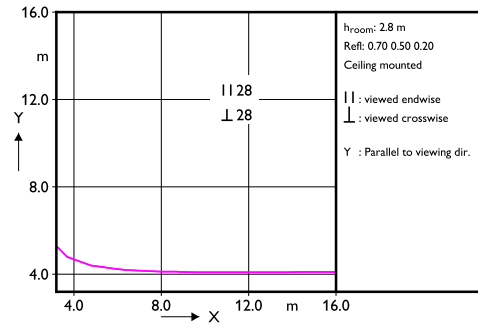


Downlight 1 x 9290046533 6500K

1 x 400 lm

Polar intensity diagram**Quantity estimation diagram****UGR diagram**

Light output ratio 1.00
Service upward 0.00
Service downward 1.00

CIE flux code 49 81 97 100 100

UGRcen (4Hx8H, 0.25H) 27

Utilisation factor table

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)											
	0.80			0.70			0.50			0.30		
	0.80	0.80	0.80	0.70	0.70	0.70	0.50	0.50	0.50	0.30	0.30	0.00
0.60	0.80	0.80	0.80	0.50	0.50	0.50	0.30	0.10	0.30	0.10	0.00	0.00
0.80	0.30	0.10	0.30	0.20	0.10	0.10	0.10	0.10	0.10	0.10	0.00	0.00
1.00	0.49	0.47	0.49	0.47	0.46	0.39	0.39	0.34	0.38	0.34	0.32	0.32
1.25	0.60	0.57	0.59	0.57	0.56	0.48	0.48	0.43	0.47	0.43	0.41	0.41
1.50	0.69	0.64	0.68	0.66	0.63	0.56	0.55	0.51	0.55	0.50	0.48	0.48
2.00	0.78	0.71	0.76	0.73	0.70	0.64	0.63	0.58	0.62	0.58	0.55	0.55
2.50	0.84	0.77	0.82	0.79	0.76	0.69	0.68	0.64	0.67	0.63	0.61	0.61
3.00	0.94	0.84	0.92	0.87	0.83	0.78	0.77	0.73	0.75	0.72	0.70	0.70
4.00	1.01	0.89	0.98	0.93	0.88	0.84	0.82	0.79	0.81	0.78	0.75	0.75
5.00	1.06	0.93	1.03	0.97	0.91	0.88	0.86	0.83	0.85	0.82	0.79	0.79
	1.12	0.97	1.08	1.01	0.95	0.92	0.91	0.88	0.89	0.87	0.84	0.84
	1.15	0.99	1.12	1.04	0.98	0.95	0.93	0.91	0.92	0.90	0.87	0.87

Ceiling mounted

Luminance Table

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0	27581	27581	27581	27581	27581	27581	27581
50.0	26832	26832	26832	26832	26832	26832	26832
55.0	25223	25223	25223	25223	25223	25223	25223
60.0	23027	23027	23027	23027	23027	23027	23027
65.0	21596	21596	21596	21596	21596	21596	21596
70.0	20212	20212	20212	20212	20212	20212	20212
75.0	18131	18131	18131	18131	18131	18131	18131
80.0	14012	14012	14012	14012	14012	14012	14012
85.0	3697	3697	3697	3697	3697	3697	3697
90.0	2799	2799	2799	2799	2799	2799	2799

(cd/m²)

2024-11-11