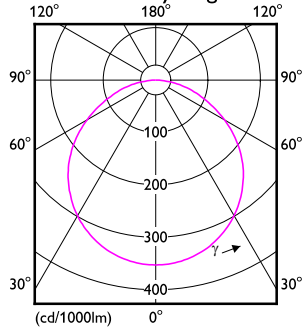


Downlight 1 x 9290046553 6500K

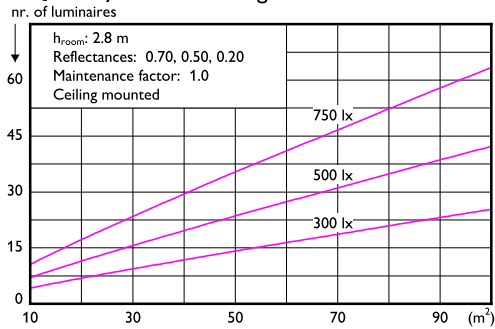
1 x 1300 lm

Polar intensity diagram

Light output ratio 1.00
 Service upward 0.00
 Service downward 1.00

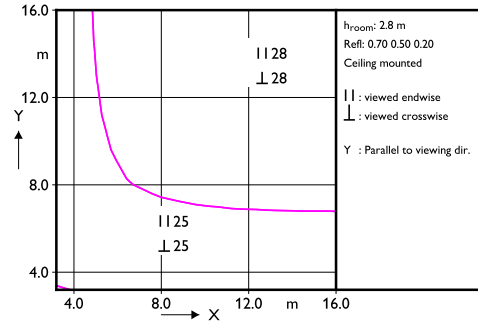
CIE flux code 47 79 96 100 100

UGRcen (4Hx8H, 0.25H) 26

Quantity estimation diagram**Utilisation factor table**

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)											
	0.80 0.80			0.70 0.70 0.70 0.70				0.50 0.50		0.30 0.30		0.00
	0.50 0.50			0.50 0.50 0.50 0.30				0.30 0.10		0.30 0.10		
	0.30 0.10			0.30 0.20 0.10 0.10				0.10 0.10				
0.60	0.48	0.46	0.47	0.46	0.45	0.38	0.37	0.32	0.37	0.32	0.30	
0.80	0.59	0.55	0.58	0.56	0.55	0.47	0.46	0.41	0.46	0.41	0.39	
1.00	0.68	0.63	0.66	0.64	0.62	0.55	0.54	0.49	0.53	0.49	0.46	
1.25	0.77	0.70	0.75	0.72	0.69	0.62	0.61	0.56	0.60	0.56	0.54	
1.50	0.83	0.75	0.81	0.78	0.74	0.68	0.67	0.62	0.66	0.62	0.59	
2.00	0.93	0.83	0.91	0.86	0.82	0.77	0.75	0.71	0.74	0.71	0.68	
2.50	1.00	0.88	0.97	0.92	0.87	0.82	0.81	0.77	0.80	0.76	0.74	
3.00	1.05	0.92	1.02	0.96	0.90	0.86	0.85	0.82	0.83	0.81	0.78	
4.00	1.11	0.96	1.07	1.01	0.95	0.91	0.90	0.87	0.88	0.86	0.83	
5.00	1.14	0.98	1.11	1.04	0.97	0.94	0.93	0.90	0.91	0.89	0.86	

Ceiling mounted

UGR diagram**Luminance Table**

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0							
50.0							
55.0							
60.0							
65.0							
70.0							
75.0							
80.0							
85.0							
90.0							

Cannot draw luminance table:
the apparent area equals zero.(cd/m²)

2024-11-12