



1 x 929002405700

1 x 2600 lm


Polar intensity diagram

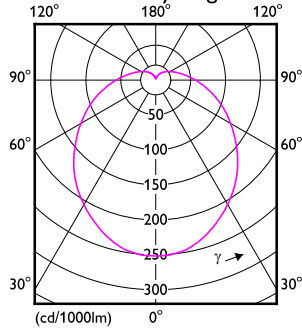

Quantity estimation diagram

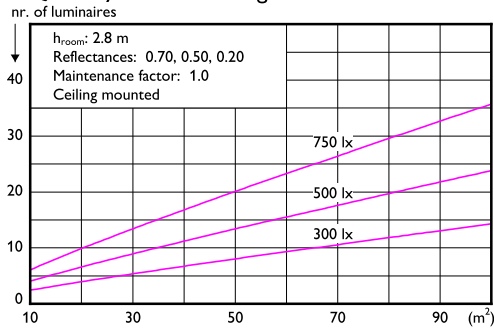

UGR diagram

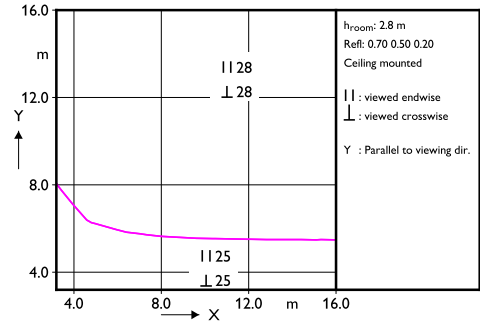

Light output ratio 1.00
Service upward 0.16
Service downward 0.84

CIE flux code 39 67 87 84 100

UGRcen (4Hx8H, 0.25H) 27

Utilisation factor table

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)															
	0.80				0.70				0.50				0.30			
	0.80	0.80	0.50	0.50	0.70	0.70	0.70	0.70	0.50	0.50	0.30	0.30	0.30	0.30	0.00	0.00
0.60	0.80	0.80	0.50	0.50	0.70	0.70	0.70	0.70	0.50	0.50	0.30	0.30	0.30	0.30	0.00	0.00
0.80	0.50	0.50	0.30	0.30	0.20	0.20	0.10	0.10	0.10	0.10	0.10	0.10	0.10	0.10	0.00	0.00
1.00	0.60	0.56	0.58	0.56	0.54	0.46	0.44	0.39	0.42	0.37	0.33	0.33	0.33	0.33	0.33	0.33
1.25	0.68	0.62	0.65	0.63	0.60	0.53	0.50	0.45	0.47	0.43	0.38	0.38	0.38	0.38	0.38	0.38
1.50	0.74	0.67	0.71	0.68	0.65	0.58	0.55	0.50	0.52	0.48	0.43	0.43	0.43	0.43	0.43	0.43
2.00	0.84	0.75	0.80	0.76	0.73	0.66	0.63	0.58	0.59	0.55	0.50	0.50	0.50	0.50	0.50	0.50
2.50	0.90	0.80	0.86	0.82	0.77	0.72	0.68	0.64	0.64	0.60	0.55	0.55	0.55	0.55	0.55	0.55
3.00	0.95	0.83	0.91	0.85	0.81	0.76	0.71	0.68	0.67	0.64	0.58	0.58	0.58	0.58	0.58	0.58
4.00	1.02	0.88	0.97	0.91	0.85	0.81	0.76	0.73	0.72	0.69	0.63	0.63	0.63	0.63	0.63	0.63
5.00	1.06	0.91	1.00	0.94	0.88	0.84	0.80	0.77	0.75	0.73	0.66	0.66	0.66	0.66	0.66	0.66

Ceiling mounted

Luminance Table

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0	34752	30414	28201	27518	28201	30414	34752
50.0	31034	26950	24890	24258	24890	26950	31034
55.0	27801	23962	22049	21464	22049	23962	27801
60.0	24979	21373	19595	19054	19595	21373	24979
65.0	22516	19127	17474	16973	17474	19127	22516
70.0	20247	17074	15543	15082	15543	17074	20247
75.0	18154	15195	13783	13359	13783	15195	18154
80.0	16241	13489	12190	11803	12190	13489	16241
85.0	14677	12090	10884	10526	10884	12090	14677
90.0	13201	10779	9664	9335	9664	10779	13201

(cd/m²)

2020-05-21