



1 x 9290019553

1 x 710 lm


Polar intensity diagram

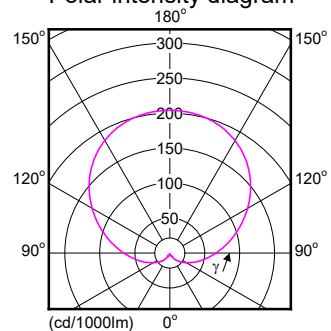

Quantity estimation diagram

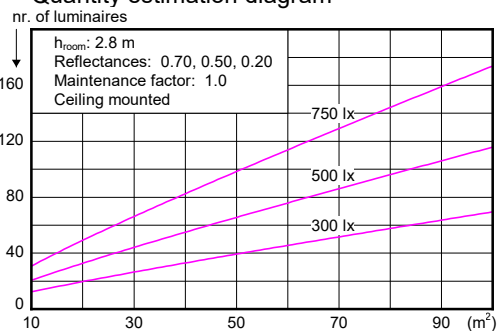

UGR diagram

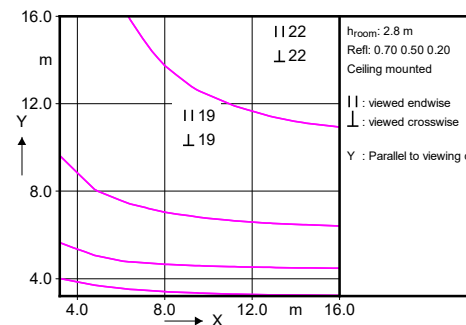

Utilisation factor table

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)														
	0.80	0.80	0.70	0.70	0.70	0.70	0.50	0.50	0.30	0.30	0.30	0.10	0.10	0.10	0.00
0.60	0.80	0.80	0.70	0.70	0.70	0.70	0.50	0.50	0.30	0.30	0.30	0.10	0.10	0.10	0.00
0.80	0.50	0.50	0.50	0.50	0.50	0.50	0.30	0.30	0.10	0.10	0.10	0.10	0.10	0.10	0.00
1.00	0.30	0.30	0.30	0.30	0.30	0.30	0.20	0.20	0.10	0.10	0.10	0.10	0.10	0.10	0.00
1.25	0.60	0.60	0.60	0.60	0.60	0.60	0.50	0.50	0.30	0.30	0.30	0.10	0.10	0.10	0.00
1.50	0.42	0.42	0.42	0.42	0.42	0.42	0.36	0.36	0.24	0.24	0.24	0.16	0.16	0.16	0.01
2.00	0.49	0.49	0.49	0.49	0.49	0.49	0.42	0.42	0.33	0.33	0.33	0.24	0.24	0.24	0.02
2.50	0.56	0.56	0.56	0.56	0.56	0.56	0.48	0.48	0.38	0.38	0.38	0.28	0.28	0.28	0.02
3.00	0.61	0.61	0.61	0.61	0.61	0.61	0.53	0.53	0.42	0.42	0.42	0.31	0.31	0.31	0.03
4.00	0.69	0.69	0.69	0.69	0.69	0.69	0.60	0.60	0.49	0.49	0.49	0.36	0.36	0.36	0.04
5.00	0.75	0.75	0.75	0.75	0.75	0.75	0.65	0.65	0.58	0.58	0.58	0.39	0.39	0.39	0.05
	0.79	0.79	0.79	0.79	0.79	0.79	0.68	0.68	0.61	0.61	0.61	0.42	0.42	0.42	0.06
	0.85	0.85	0.85	0.85	0.85	0.85	0.74	0.74	0.69	0.69	0.69	0.45	0.45	0.45	0.08
	0.89	0.89	0.89	0.89	0.89	0.89	0.77	0.77	0.72	0.72	0.72	0.48	0.48	0.48	0.09

Ceiling mounted

Luminance Table

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0	1891	1891	1891	1891	1891	1891	1891
50.0	2254	2254	2254	2254	2254	2254	2254
55.0	2657	2657	2657	2657	2657	2657	2657
60.0	3129	3129	3129	3129	3129	3129	3129
65.0	3667	3667	3667	3667	3667	3667	3667
70.0	4279	4279	4279	4279	4279	4279	4279
75.0	5013	5013	5013	5013	5013	5013	5013
80.0	5872	5872	5872	5872	5872	5872	5872
85.0	6915	6915	6915	6915	6915	6915	6915
90.0	8158	8158	8158	8158	8158	8158	8158

(cd/m²)

Light output ratio 1.00
Service upward 0.82
Service downward 0.18

CIE flux code 5 22 53 18 100

UGR_{cen} (4Hx8H, 0.25H) 19

RZ080504

2018-06-28