



1 x 9290020043 6500K 23W

1 x 2700 lm


Polar intensity diagram

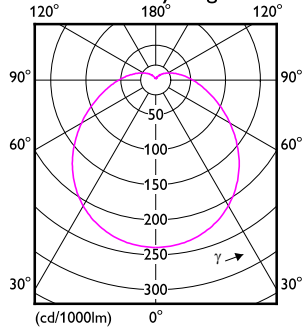

Quantity estimation diagram

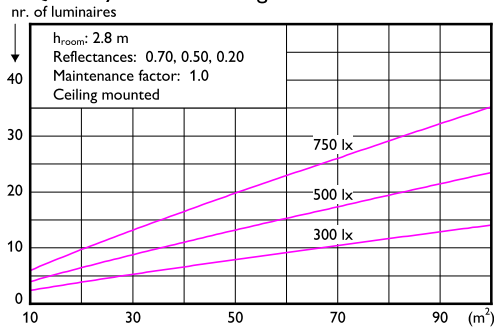

UGR diagram

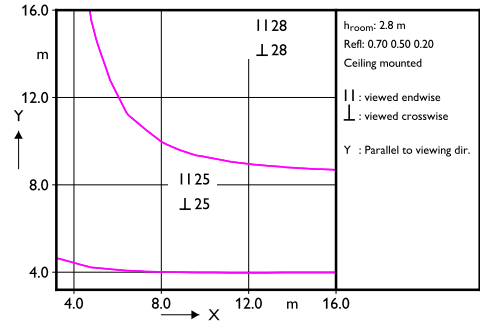

Light output ratio 0.97
Service upward 0.15
Service downward 0.82

CIE flux code 40 68 87 85 97

UGRcen (4Hx8H, 0.25H) 26

Utilisation factor table

Room Index k	Reflectances (%) for ceiling, walls and working plane (CIE)															
	0.80	0.80	0.70	0.70	0.70	0.70	0.50	0.50	0.30	0.30	0.00	0.80	0.80	0.70	0.70	0.70
0.60	0.30	0.10	0.30	0.20	0.10	0.10	0.10	0.10	0.10	0.10	0.00	0.30	0.10	0.30	0.20	0.10
0.80	0.42	0.40	0.40	0.39	0.38	0.31	0.30	0.25	0.28	0.24	0.21	0.42	0.40	0.40	0.39	0.31
1.00	0.51	0.48	0.49	0.48	0.47	0.39	0.37	0.32	0.35	0.31	0.28	0.51	0.48	0.49	0.48	0.39
1.25	0.59	0.55	0.57	0.55	0.53	0.46	0.43	0.38	0.41	0.37	0.33	0.59	0.55	0.57	0.55	0.46
1.50	0.67	0.61	0.64	0.62	0.59	0.52	0.49	0.44	0.47	0.43	0.38	0.67	0.61	0.64	0.62	0.52
2.00	0.73	0.66	0.70	0.67	0.64	0.57	0.54	0.49	0.51	0.47	0.43	0.73	0.66	0.70	0.67	0.57
2.50	0.82	0.73	0.78	0.74	0.71	0.65	0.61	0.57	0.58	0.54	0.49	0.82	0.73	0.78	0.74	0.65
3.00	0.88	0.78	0.84	0.80	0.75	0.70	0.66	0.62	0.63	0.59	0.54	0.88	0.78	0.84	0.80	0.70
4.00	0.93	0.81	0.88	0.83	0.79	0.74	0.70	0.66	0.66	0.63	0.58	0.93	0.81	0.88	0.83	0.74
5.00	0.99	0.86	0.94	0.88	0.83	0.79	0.75	0.72	0.71	0.68	0.62	0.99	0.86	0.94	0.88	0.79
5.00	1.03	0.88	0.98	0.91	0.86	0.82	0.78	0.75	0.74	0.71	0.65	1.03	0.88	0.98	0.91	0.82

Ceiling mounted

Luminance Table

Plane Cone	0.0	15.0	30.0	45.0	60.0	75.0	90.0
45.0	17667	16411	15709	15483	15709	16411	17667
50.0	16595	15287	14565	14334	14565	15287	16595
55.0	15520	14169	13434	13200	13434	14169	15520
60.0	14515	13123	12377	12141	12377	13123	14515
65.0	13567	12134	11379	11142	11379	12134	13567
70.0	12735	11252	10485	10246	10485	11252	12735
75.0	12067	10512	9724	9482	9724	10512	12067
80.0	11605	9940	9118	8867	9118	9940	11605
85.0	11434	9591	8709	8444	8709	9591	11434
90.0	11462	9358	8390	8105	8390	9358	11462

(cd/m²)

2020-08-28